




# Non-Friable Asbestos Removal Class B

Under the Health and Safety at Work (Asbestos) Regulations 2016, a PCBU [a company, sole trader, or self-employed person] is required to have an Asbestos Removal Licence issued by WorkSafe to legally remove more than 10m<sup>2</sup> of non-friable asbestos [Class B].



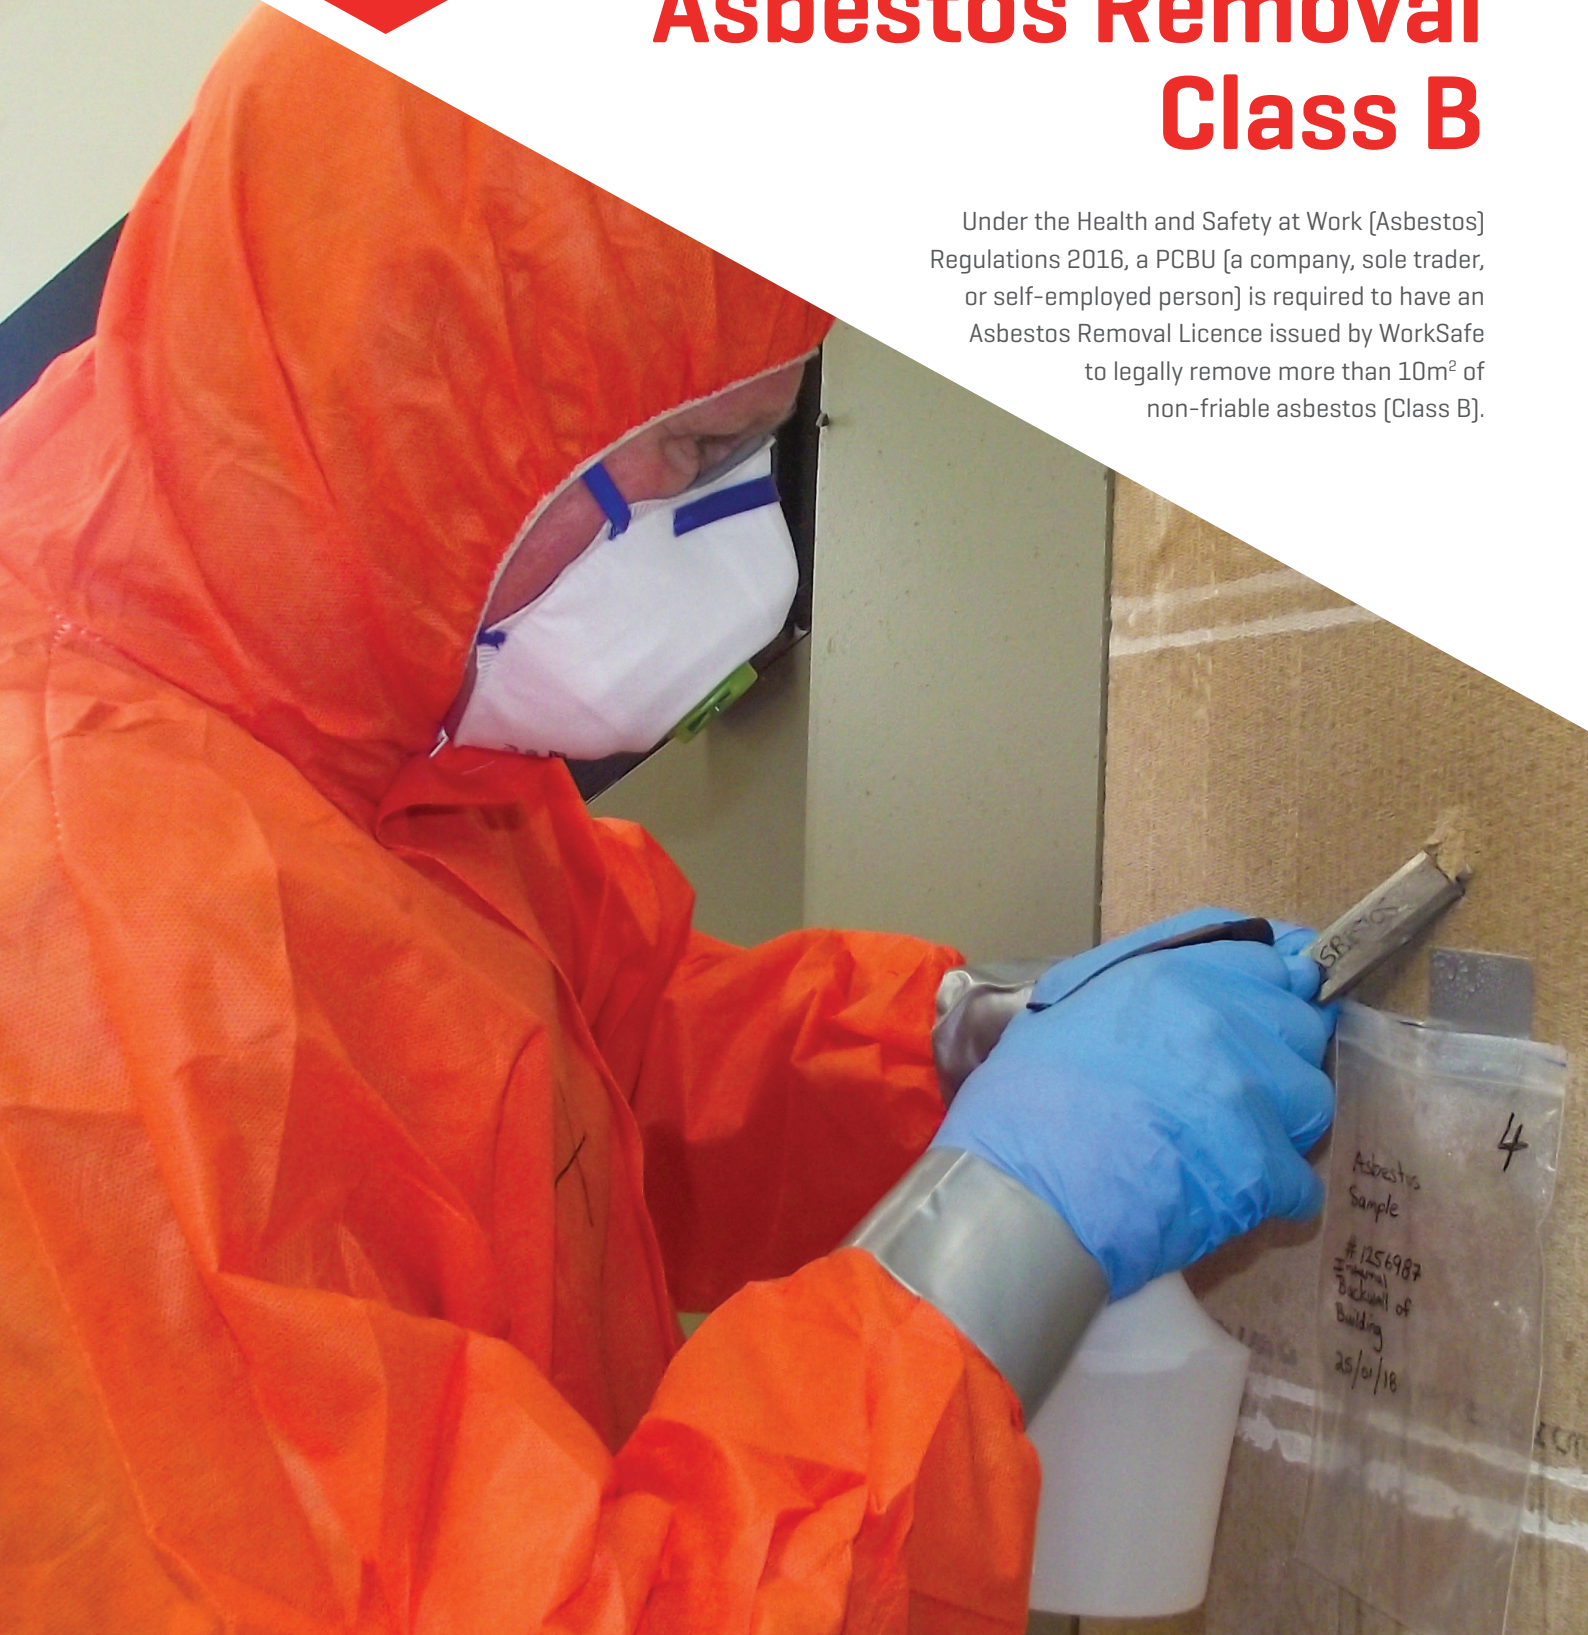

# Non-Friable Asbestos Removal Class B

**Under the Health and Safety at Work (Asbestos) Regulations 2016, a PCBU (a company, sole trader, or self-employed person) is required to have an Asbestos Removal Licence issued by WorkSafe to legally remove more than 10m<sup>2</sup> of non-friable asbestos (Class B).**

NZQA accredited training is a prerequisite of the new licensing system for all workers and supervisors. This interactive course is designed for anyone working on a site likely to contain Asbestos, or anyone who may be required to sample or remove any amount of Non-Friable Asbestos or Asbestos Containing Material (ACM). This includes builders, electricians, plumbers, drain layers and other trades.

## Key Learning Outcomes:

- ✓ Identification of Asbestos and ACM
- ✓ Demonstrate knowledge of the associated health risks
- ✓ Interpret relevant legislation and new asbestos licencing rules
- ✓ Select and use appropriate Personal and Respiratory Protective Equipment
- ✓ Take samples safely for laboratory analysis
- ✓ Follow safe removal procedures for non-friable asbestos and ACM
- ✓ Understand requirements for containment and safe disposal of asbestos
- ✓ Conduct personal decontamination procedures

## NON-FRIABLE ASBESTOS REMOVAL CLASS B

<b>Unit 2138</b>	Demonstrate knowledge of asbestos and safety procedures
<b>Unit 29765</b>	Remove non-friable asbestos
<b>Prerequisites</b>	Demonstrated experience, skills and knowledge in Health and Safety in the construction or trades professions
<b>Course Duration</b>	Two Days (16 Hours)
<b>Availability</b>	<ul style="list-style-type: none"> <li>✓ Nationwide at one of our training centres</li> <li>✓ At your own site or workplace</li> </ul>